
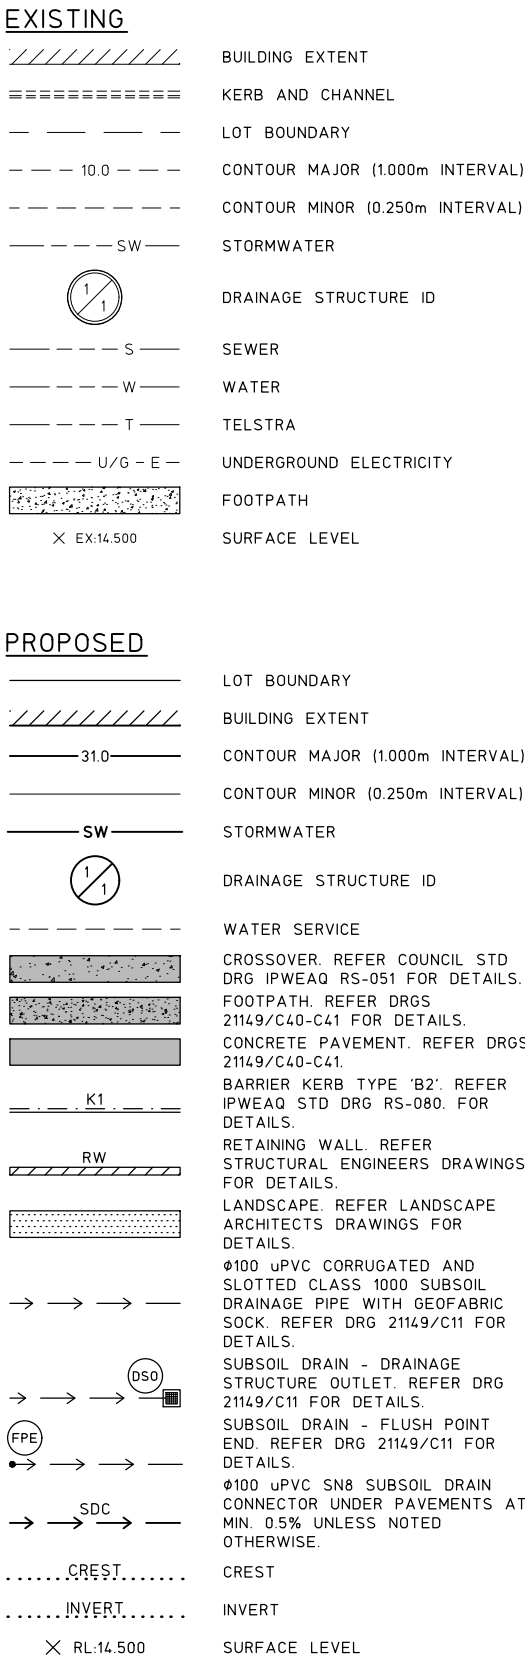




1. SITEWORKS AND DRAINAGE NOTES ARE TO BE READ IN CONJUNCTION WITH THE GENERAL AND COORDINATION NOTES ON DRAWING 211/9/C00.
2. CONTRACTOR IS TO CHECK THAT THE PROPOSED WORKS DO NOT CLASH WITH EXISTING SERVICES PRIOR TO CONSTRUCTION. THE CONTRACTOR SHALL NOTIFY THE ENGINEER IF ANY CLASHES ARE FOUND FOR ADVICE ON ANY DESIGN REQUIREMENTS.
3. STRUCTURES HAVE BEEN DESIGNED FOR OPERATIONAL LOADS ONLY. THE CONTRACTOR IS RESPONSIBLE FOR THE ASSESSMENT OF CONSTRUCTION LOADS AND PROVISION OF ANY TEMPORARY BRACING, PROPPING, ETC. REQUIRED DURING CONSTRUCTION. STRUCTURES SHALL BE MAINTAINED IN A STABLE CONDITION AND NO PART SHALL BE OVERSTRESSED.
4. ALL TRENCH EXCAVATIONS AND CONSTRUCTION IS TO BE IN ACCORDANCE WITH THE WORKPLACE HEALTH AND SAFETY 1989 AS AMENDED AND THE MINE REGULATIONS ACT.
5. ALL TRENCHES IN TRAFFICABLE AND NON TRAFFICABLE ZONES SHALL BE BACKFILLED TO DENSITY RATIOS, FREQUENCIES AND LAYER INTERVALS IN ACCORDANCE WITH THE CURRENT COUNCIL STANDARDS. ALL TEST RESULTS SHALL FORWARDED TO THE SUPERINTENDENT AS THEY BECOME AVAILABLE.
6. ALL PRECAST CONCRETE PIPES ARE TO BE MANUFACTURED IN ACCORDANCE WITH AS 4058. STORMWATER PIPES SHALL BE TO FOLLOWING CLASSES U.N.O.
 - 6.A. REINFORCED CONCRETE PIPES (RCP) = CLASS 2;
 - 6.B. FIBRE REINFORCED PIPES (FRC) = CLASS 2.
7. ALL PIPES IN COUNCIL ROAD CORRIDOR TO BE RCP.
8. ALL RCP PIPES SHALL HAVE THE FOLLOWING JOINTS U.N.O.
 - 8.A. RCP <=600 DIA = RUBBER RING JOINTED (RRJ).
 - 8.B. RCP >600 DIA = FLUSH JOINTED (FJ).
9. ROOFWATER PIPES SHALL BE uPVC PIPES CLASS 'SN8' U.N.O.
10. GRATES SHALL BE TRAFFICABLE CLASS 'D' U.N.O. AND ALL METAL GRILLES, METAL PLATES OR SIMILAR TO VEHICULAR TRAFFIC MUST BE ACOUSTICALLY DAMPED TO PREVENT ENVIRONMENTAL NUISANCE.
11. MANHOLE AND FIELD INLET ACCESS SHALL BE INSTALLED AS DESCRIBED BELOW IN ACCORDANCE WITH AS1657:
 - 11.A. GULLY/FIELD INLETS >1.35m DEPTH: STEP IRONS;
 - 11.B. MANHOLES 0.850m-3.0m DEPTH: STEP IRONS;
 - 11.C. MANHOLES >3.0m DEPTH: FIXED ACCESS LADDER.
12. TEST CERTIFICATES AND MATERIAL CERTIFICATION DOCUMENTATION IS REQUIRED FOR ALL PIPES, FITTINGS, BOX CULVERTS AND OTHER PRECAST CONCRETE PRODUCTS.
13. ALL STORMWATER SETOUT IS TO CENTRE OF STRUCTURE U.N.O.
14. THE CONTRACTOR SHALL ERECT TRAFFIC CONTROL DEVICES IN ACCORDANCE WITH THE RELEVANT SPECIFICATIONS.
15. WHERE CONNECTION IS TO BE MADE TO ANY EXISTING CONSTRUCTION, THE CONTRACTOR SHALL CONFIRM THE LOCATION AND LEVEL OF THE CONSTRUCTION PRIOR TO COMMENCING WORK ON ANY CRITICAL SECTION. THE SUPERINTENDENT MAY VARY LEVELS AND GRADIENTS OF NEW WORKS TO ACHIEVE A SATISFACTORY CONNECTION.
16. SUBSOIL DRAINS TO BE PROVIDED AT ALL EDGE OF CONCRETE ADJACENT TO LANDSCAPING AND SUITABLY CONNECTED TO STORMWATER PITS.

NOTE:
REFER DRG 21149/C11 FOR SITEWORKS
AND DRAINAGE DETAILS.

[illegible]